


1. Low voltage installer to furnish, install, and test BMX ECS System.
2. BMX does not provide network, access control system, and elevator equipment (elevator controller).
3. Dedicated electric circuit for BMX entry panel and elevator relay rack required
4. Low voltage installer must coordinate with property to determine the number of relays required and the desired visitor experience.

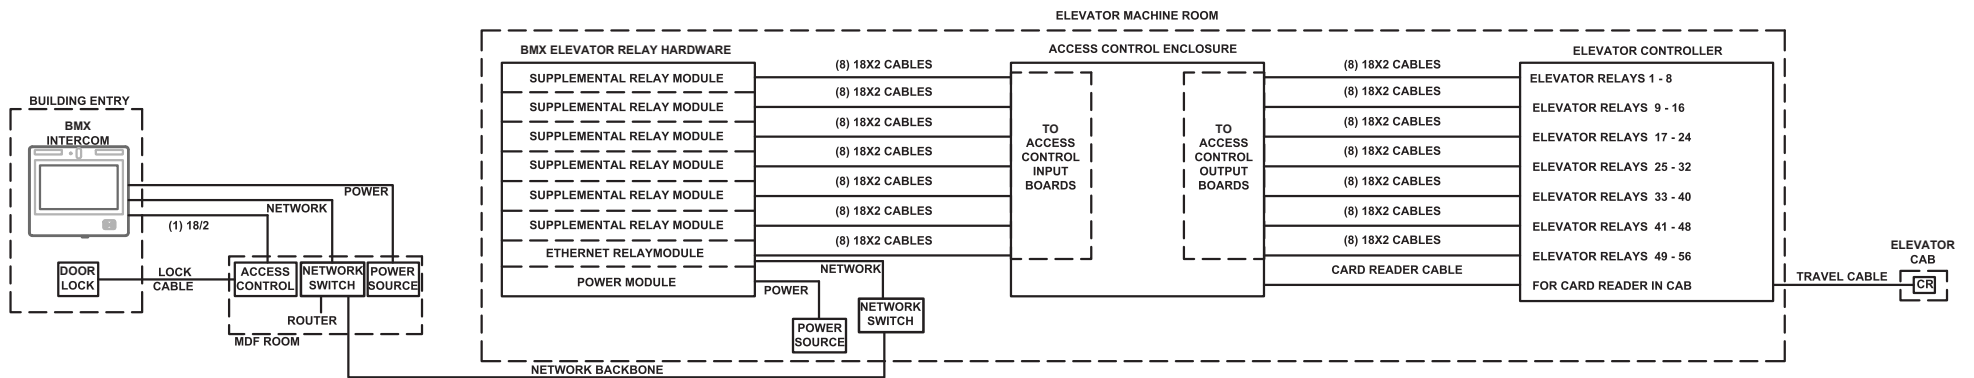

① **INTERCOM ELEVATOR CONTROL WIRING DIAGRAM**
NOT TO SCALE

Notes:

The following plans are diagrammatic. It'll be up to the installation contractor to coordinate with associated trades to formalize a complete submission for installation. Intercom mounting height to be ADA compliant.